


Scandmist test 1, LINE F

Inlet reading to prefilter before 350 R unit

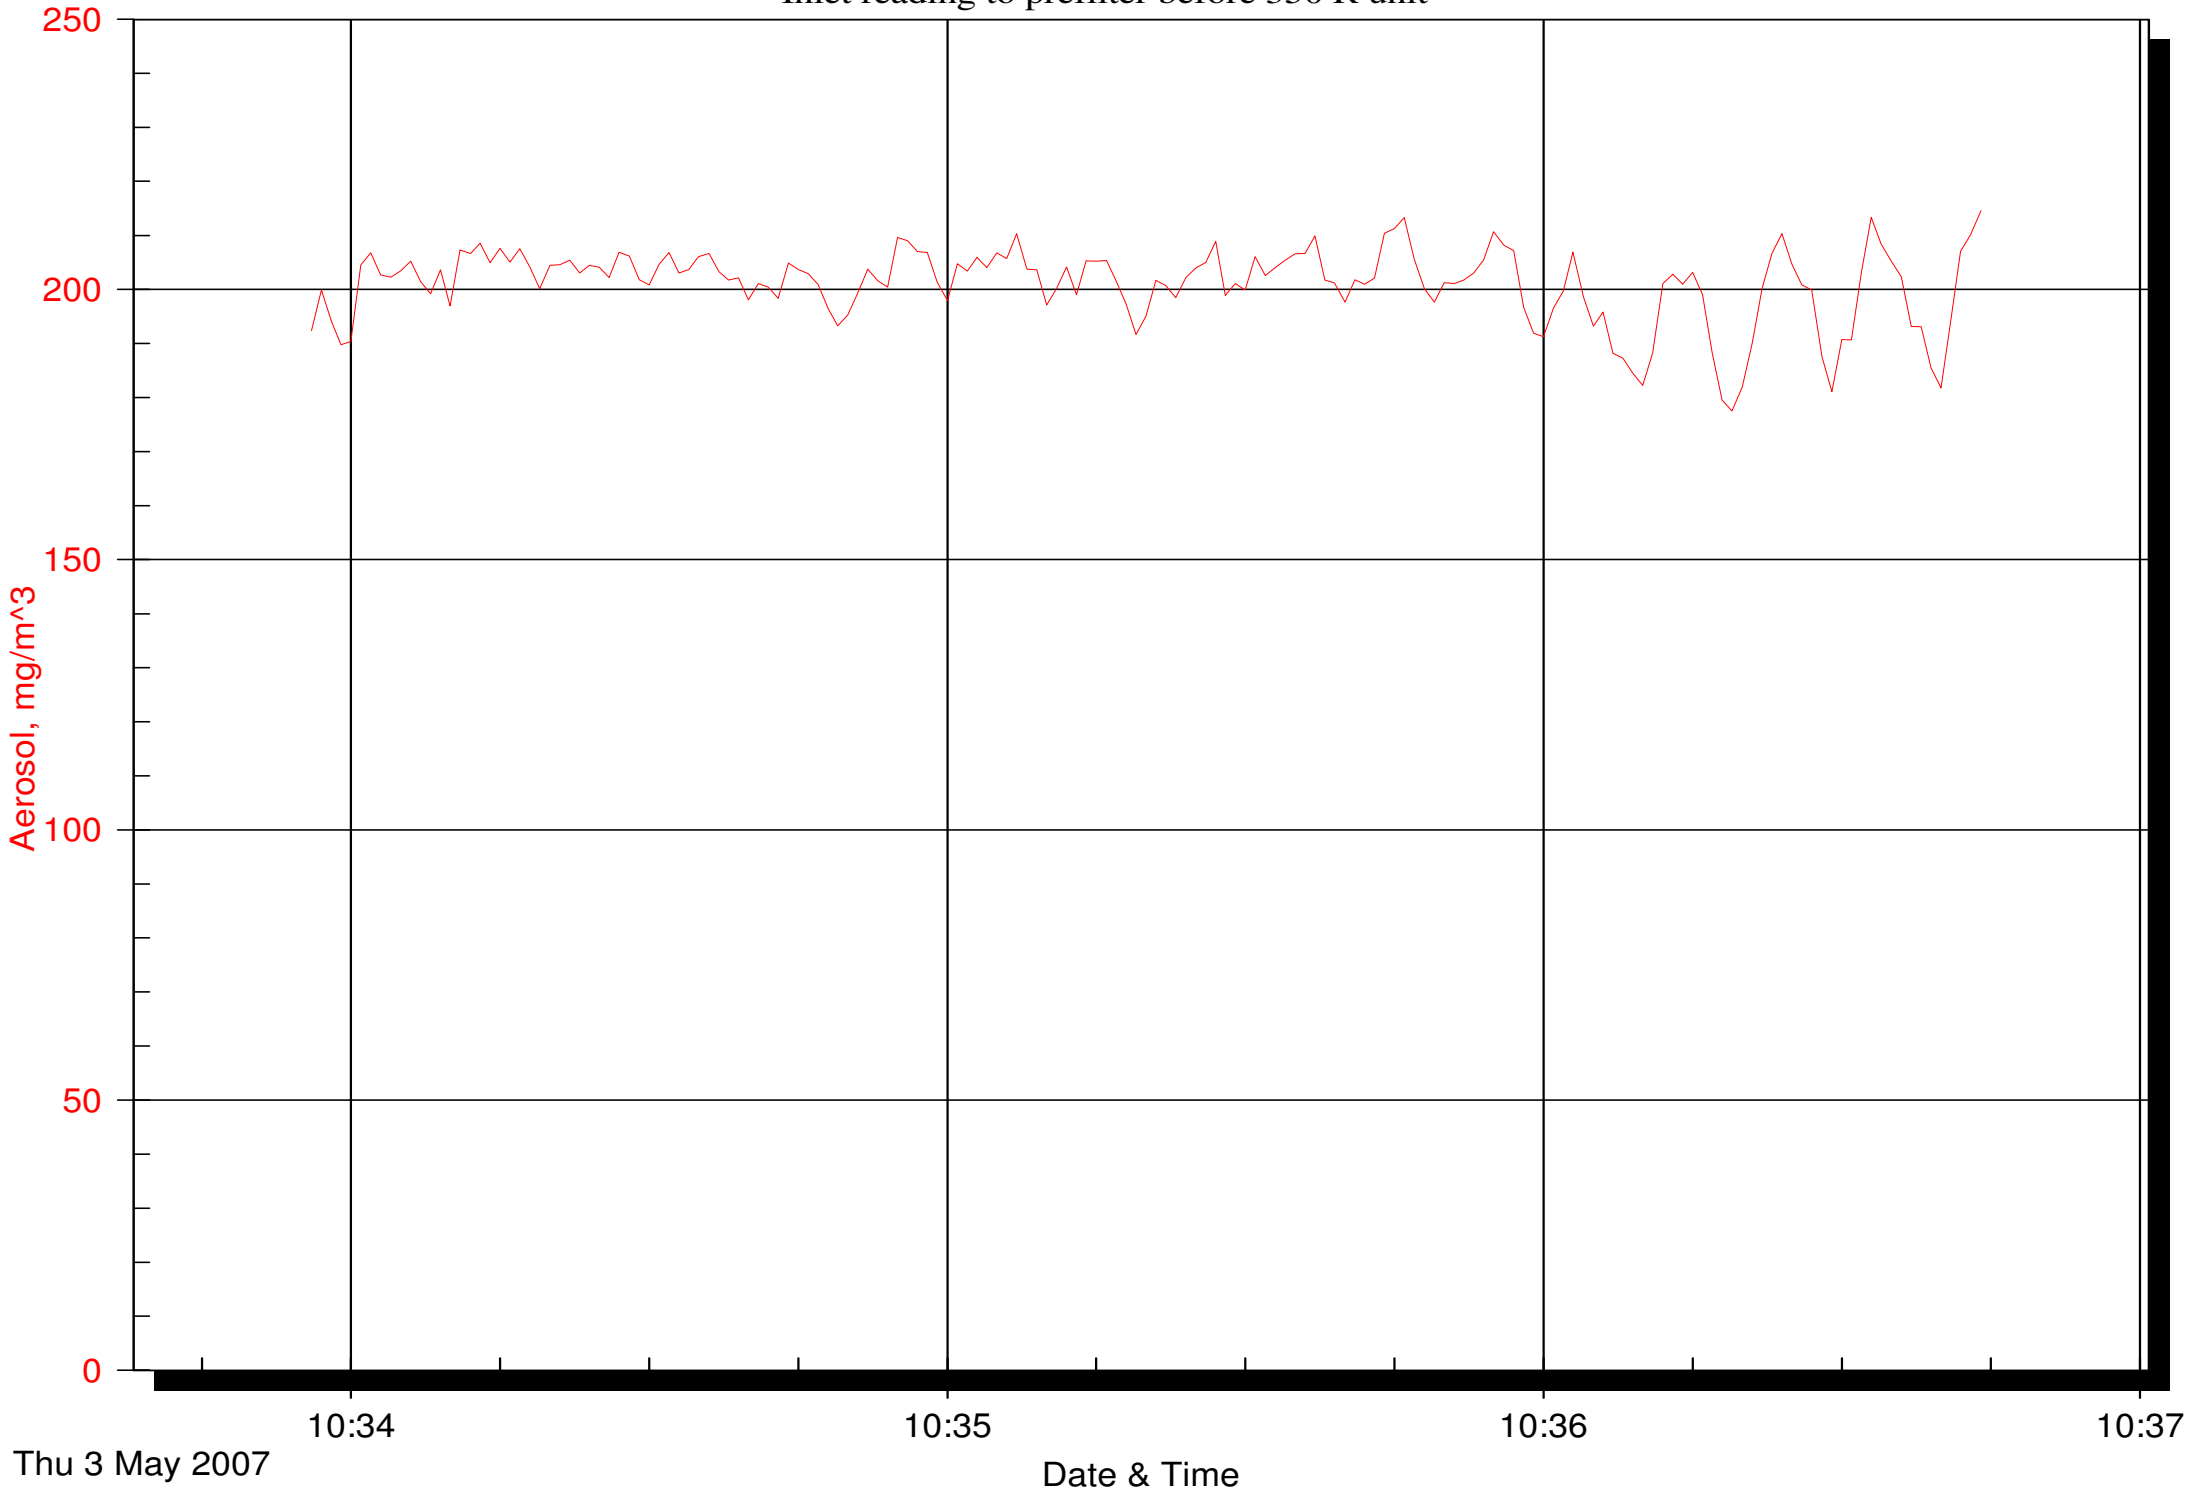

Current Graph: 1

Start time: 10:33:55 03/05/2007 Stop time: 10:36:44 03/05/2007

Legend: Aerosol

Channel: Aerosol
(Units) mg/m³

Average: 200.968


Minimum: 177.490
Time 10:36:19
Date 03/05/2007

Maximum: 214.553
Time 10:36:44
Date 03/05/2007

Log interval: 00:00:01
hh:mm:ss

Scandmist test 6; on LINE F

Discharge from Scandmist 350 R unit

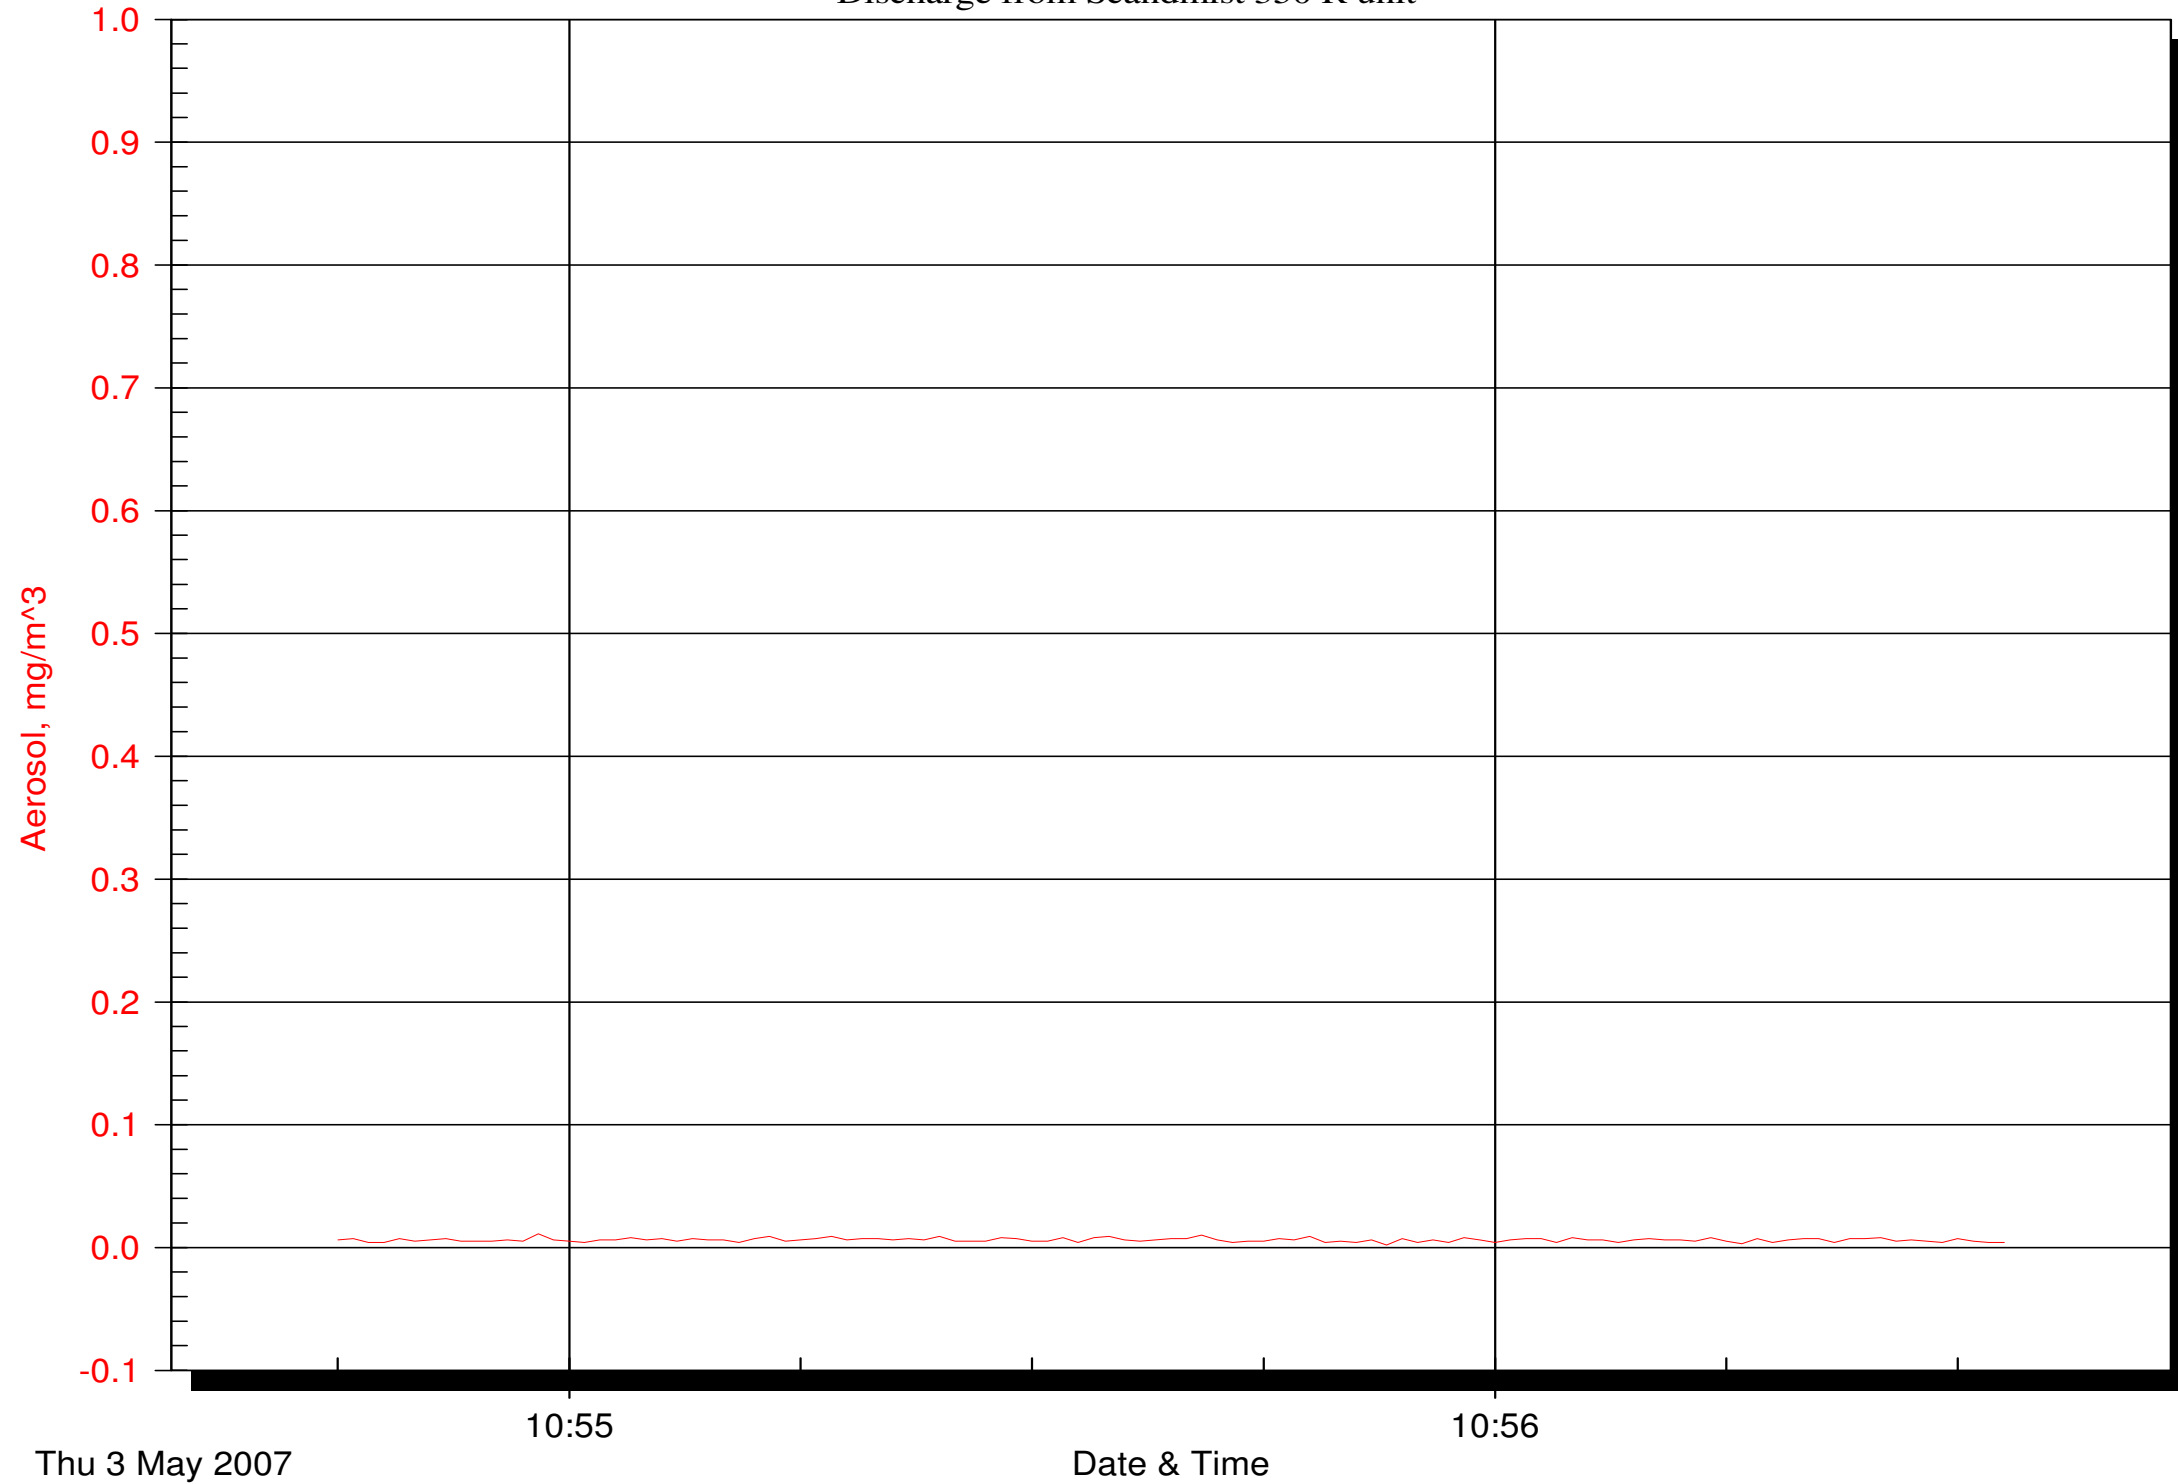

Current Graph: 6

Start time: 10:54:44 03/05/2007 Stop time: 10:56:33 03/05/2007

Legend: Aerosol

Channel: Aerosol
(Units) mg/m³

Average: 0.006

Minimum: 0.002
Time 10:55:53
Date 03/05/2007

Maximum: 0.011
Time 10:54:58
Date 03/05/2007

Log interval: 00:00:01
hh:mm:ss